

Poll



Dual Fuel options see pages 116-117

1480mm x 600mm shown in RAL 9016 with 3 Style Corner-valves.

Poll shown on page 105

Steel; 30mm square collectors, 22mm round cross tubes
Hydronic & Electric models
UKCA approved & certified to BS EN442

White RAL 9016 as standard, 188 RAL Colours and 30 Special Finishes
Please call **01342 302250** for a RAL or Special Finish chart

Stock White RAL 9016: 48-72 Hours

Made to Order sizes & colours: Up to 7 weeks: White Electric,
Up to 8 weeks: Colours




SAVE MONEY! WHEN YOU BUY OUR **CYLINDER KIT** WITH ANY TOWEL RAIL ORDER*
QUOTE **PROMOV3** AT TIME OF ORDER

Available in White or Chrome

Poll	Pipe centres left to right	Pipe centres from wall
Poll	width - 30mm	57mm to 65mm

Stock options White RAL 9016

Height (mm)	Width (mm)	Model	Watts $\Delta t 50^{\circ}c$	Btu's $\Delta t 50^{\circ}c$
530	450	POLL5345	270	921
	500	POLL5350	300	1024
	600	POLL5360	360	1228
	700	POLL5370	410	1399
1055	450	POLL1045	540	1842
	500	POLL1050	604	2061
	600	POLL1060	720	2457
	700	POLL1070	850	2900
1480	500	POLL1450	857	2924
	600	POLL1460	1030	3514
	700	POLL1470	1200	4094
	800	POLL1480	1370	4674

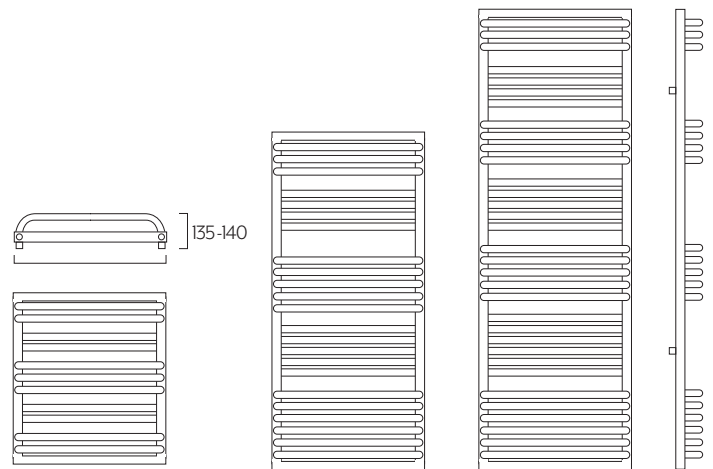

*Saving based on the value of individual items when bought separately. Order any of our selected valves & matching pipe covers at the same time as your radiator; PROMOV3W (white), PROMOV3C (chrome).

Made to order options - White Electric

Height (mm)	Width (mm)	Model	Watts $\Delta t 50^{\circ}c$
780	500	POLL7850EW	400
	600	POLL7860EW	400
1180	500	POLL1150EW	600
	600	POLL1160EW	800
1580	500	POLL1550EW	800
	600	POLL1560EW	1000

Poll Electric models supplied with a MOA Element

- 5 heat settings from 30°C to 60°C regulating the internal radiator temperature, denoted by 5 LEDs.
- No Timer.
- Compatible with external Timer as remembers settings when turned off
- 55mm diameter clock shaped face.
- 4x Buttons: Temperature +/-, Dryer, Power.
- Frost & overheating protection.
- Straight cable, no plug. IPx5. Class 1.
- Guarantee - 2 years.

Technical Specifications

Materials	Steel
Connections	½" flow and return.
Test pressure	13 Bar
Testing authority	EN442
Maximum operating pressure	10 Bar
Maximum working temperature	95 °C
Packaging	Wrapped in polythene in cardboard box

PLEASE NOTE: Systems using micro bore pipework must have adequate pressure and flow rates for the number and style of radiators on the system.

Terms & Conditions

All products must be inspected once removed from the packaging and The Radiator Company notified within 28 days of delivery of any scratches, blemishes or other damage. The Radiator Company will then replace the radiator.

Imperfect radiators should therefore not be fitted and The Radiator Company will not accept responsibility for replacement of scratched or damaged radiators once they have been fitted. This includes any consequential loss or cost of fitting.

If The Radiator Company are not notified within 28 days of the date on the signed delivery note then it will be deemed that The Radiator Company have fully complied with its obligations and claims will not be considered.

Failure to comply with any of the above may invalidate any claims.


We recommend that after you check the product on delivery that it is stored in its packaging to prevent damage prior to installation. The Radiator Company cannot accept responsibility for items damaged after delivery.

Guarantees & Liabilities

As we are not the manufacturers of this product we will take all reasonable endeavours to make over to you the benefit of any warranty or guarantee given by the manufacturer, which is usually five years on most of our range. (Copies of specific guarantees for any of our products are available on request).

The guarantees in all cases are subject to the products being installed in accordance with British and or European standards as well as these fitting instructions. The guarantees in all cases are restricted to the free of charge replacement or repair of the failed product only. Our liability will under no circumstances extend beyond the repair or replacement of the product supplied by us. Claims for either labour in replacement or damage to property are not admissible. Any goods that are returned, in the event of a problem, will belong to The Radiator Company.

Fittings Instructions

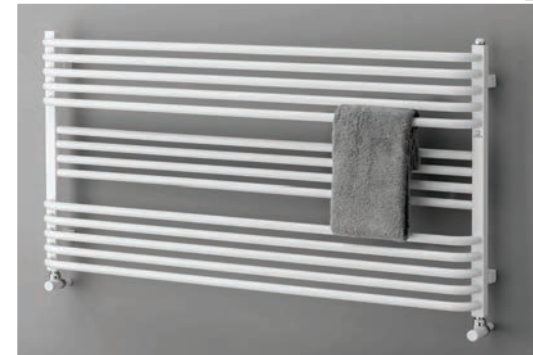

Please read these instructions and terms and conditions carefully prior to installation.



Failure to do so may invalidate the warranty

The Radiator Company
Units 13 - 14 Charlwoods Road
East Grinstead
West Sussex
RH19 2HU

POLL1.2



Diagrams of Poll Range

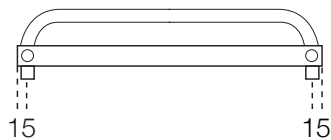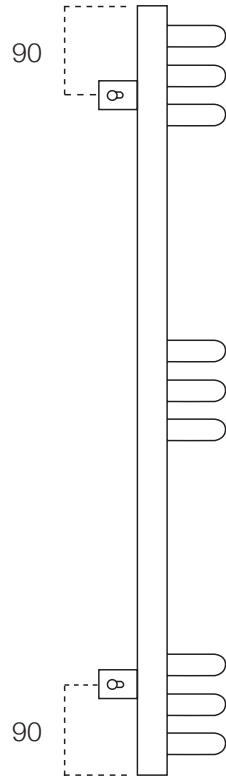

Pipe Centres

Pipe centres left to right	width - 30mm
Pipe centres from wall	57mm - 65mm
Depth from wall	132mm - 140mm

1 Unpack & Inspect

The Radiator Company prides itself on selecting products from manufacturers who exercise tight quality control measures. We only select models with excellent standards of welding and brazing, as well as high quality finishes.

All of our products are well packaged and should reach you in perfect condition. Just in case however, we offer a minimum 5-year no quibble guarantee for all radiators and towel rails.

Please carefully unpack and inspect this radiator and all fittings.

The Radiator Company must be notified of any shortages or damage within 28 days of delivery.



For further information please see terms and conditions on back page.

2 Contents

You should have:

- 1 Radiator
- 4 Wall bracket sleeves
- 1 Airvent

You will need:

- Tape measure
- Electric drill and bits
- Spirit level


3 Mark Bracket Positions

The fixing positions for the two top brackets are measured at 15mm in from either end of the top collector and measured down 90mm (please see diagram opposite).

In order to accurately mark the bottom bracket fixing positions we recommend you mark, fix and level the two top brackets first. Then hang the radiator, ensuring it is vertically level and manually hold the bottom brackets in position while marking.

4 Fix Brackets

Using a suitable drill bit, screws and plugs, fix the brackets sleeves to the wall and level with a spirit level. Please see diagrams.



PLEASE NOTE :

It is essential that all brackets are level to ensure a vertical alignment for connecting the pipework.

5 Hang Radiator & Commission

With the brackets sleeves firmly fixed and level, slot the radiator into the sleeves and firmly fix by tightening the grub screws.

When securing the brackets, we suggest positioning the sleeves in a way which the top bracket's grub screw is facing upwards, and the bottom bracket's grub screw is facing down. This will improve the aesthetics of the radiator and avoid any screws being seen.

Please Note:

In accordance with Part L1 2006 of the Building Regulations and BS7593:1992 code of practice for the treatment of hot water and central heating systems, we strongly recommend flushing the heating system post installation of new radiators and then adding the correct quantity and type of inhibitor for use with your radiator and system to prevent corrosion. Damage caused to systems not protected by a suitable inhibitor will not be covered by manufacturer's guarantee.