

All dimensions shown are in millimetres

Max working pressure: **5 BAR**
 Max working temperature: **120° C**
 All steel construction: **dia 31.8mm round tubes**
 Connections: **½ inch BSP tapings**


Heat output determined in accordance with EN 442

Model	Output $\Delta T=30K$ Watts	Output $\Delta T=50K$ Watts	n	Water Content litres	Weight kg	Height $\pm 2mm$	Length $\pm 2mm$	Tapping Centres $\pm 2mm$	Fixing Centres $\pm 5mm$
BUCK	91	175	1.23	1.9	8	750	500	425	n/a

Tools & Material Required

Suitable valves
 PTFE tape
 Silicone thread sealant
 Allen key - 13mm & 12mm (when installing Bisque valves)
 Spanner - 13mm & 14mm
 Screwdriver - crosshead
 Electric drill
 Masonry drill bit

Key	Component	Qty
A	Air Vent	1
B	Screw	12

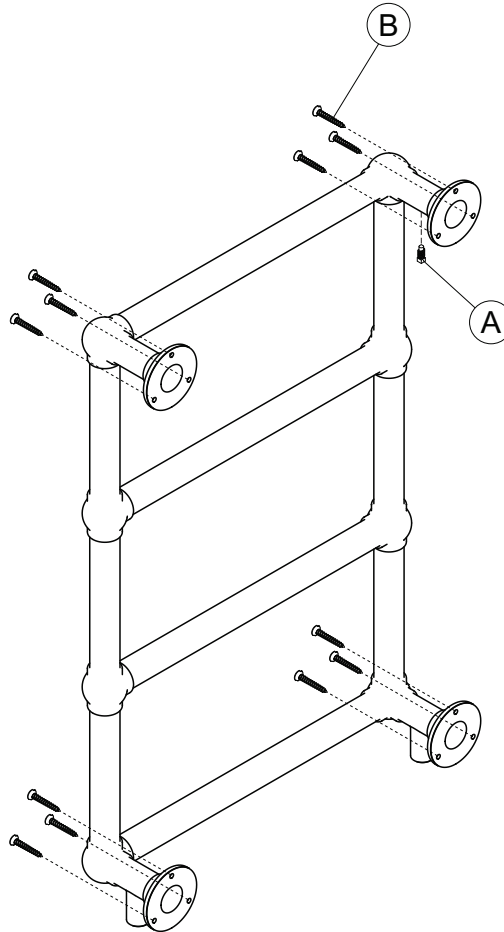

Assembly Instructions

Sufficient PTFE tape must be applied to valve-tail threads prior to their installation.
 Silicone thread sealant should be applied to all threaded components manufactured with 'O-rings'.

Fit valve tails, using correct size Allen key.

Fit air vent (A).

Accurately mark out bracket holes on floor.

Drill twelve fixing holes. Screws (B) are supplied but ensure that appropriate fixings are used for the type of wall the radiator is being mounted on.

Screw radiator to wall.

Plumb radiator to heating circuit. To enable more efficient bleeding of the radiator, it is recommended that the flow enters the radiator in the right-hand header.

This radiator should be installed onto a central heating system that has been cleaned/flushed and contains water treatment and inhibitors in accordance with BS7593.